



VENT NOTES:


- I. VENT MUST BE PLACED AT A CONTINUOUS SLOPE ON A FIRM, COMPACT BASE
- 2. VENT MUST SLOPE A MINIMUM OF 0.5%
- 3. SYSTEM IS NOT ALLOWED TO VENT TO DRIP IRRIGATION OR TO A SHALLOW DISPOSAL FIELD
- 4. SITES WHICH DO NOT PERMIT A CONTINUOUS SLOPE AWAY FROM THE REACTOR, OR WHICH CANNOT BE VENTED TO THE DISPOSAL AREA WILL BE VENTED TO AN EXTERNAL VENT
- 5. EXTERNAL VENT MUST BE PROTECTED AGAINST ANIMAL ENTRY AND BE FITTED WITH A CARBON FILTER

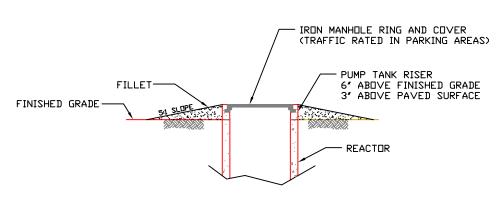

TYPICAL CLEARWELL RISER DETAIL

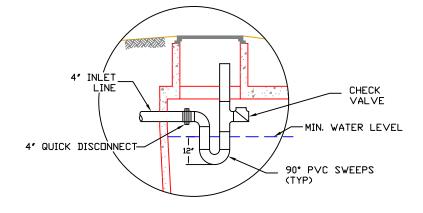

INFLUENT SAMPLE PIPING DETAIL

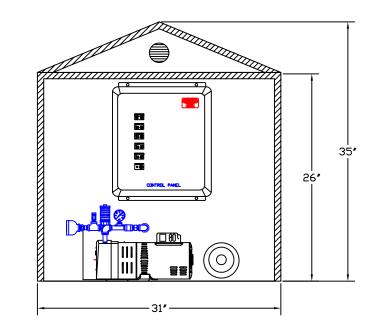

BLOWER AND CONTROL PANEL ENCLOSURE

Dwg: Rev:	AMPHIDR	:□ME Œ	DETAILS
Drawn by: ARM	App'd by:		
Scale: NTS	Date	06/19	9/07
F M AHDNY & associates, inc. Water Supply & Pollution Control Equipment 273 Weymouth Street, Rockland, Massachusetts 02370		pg.	